


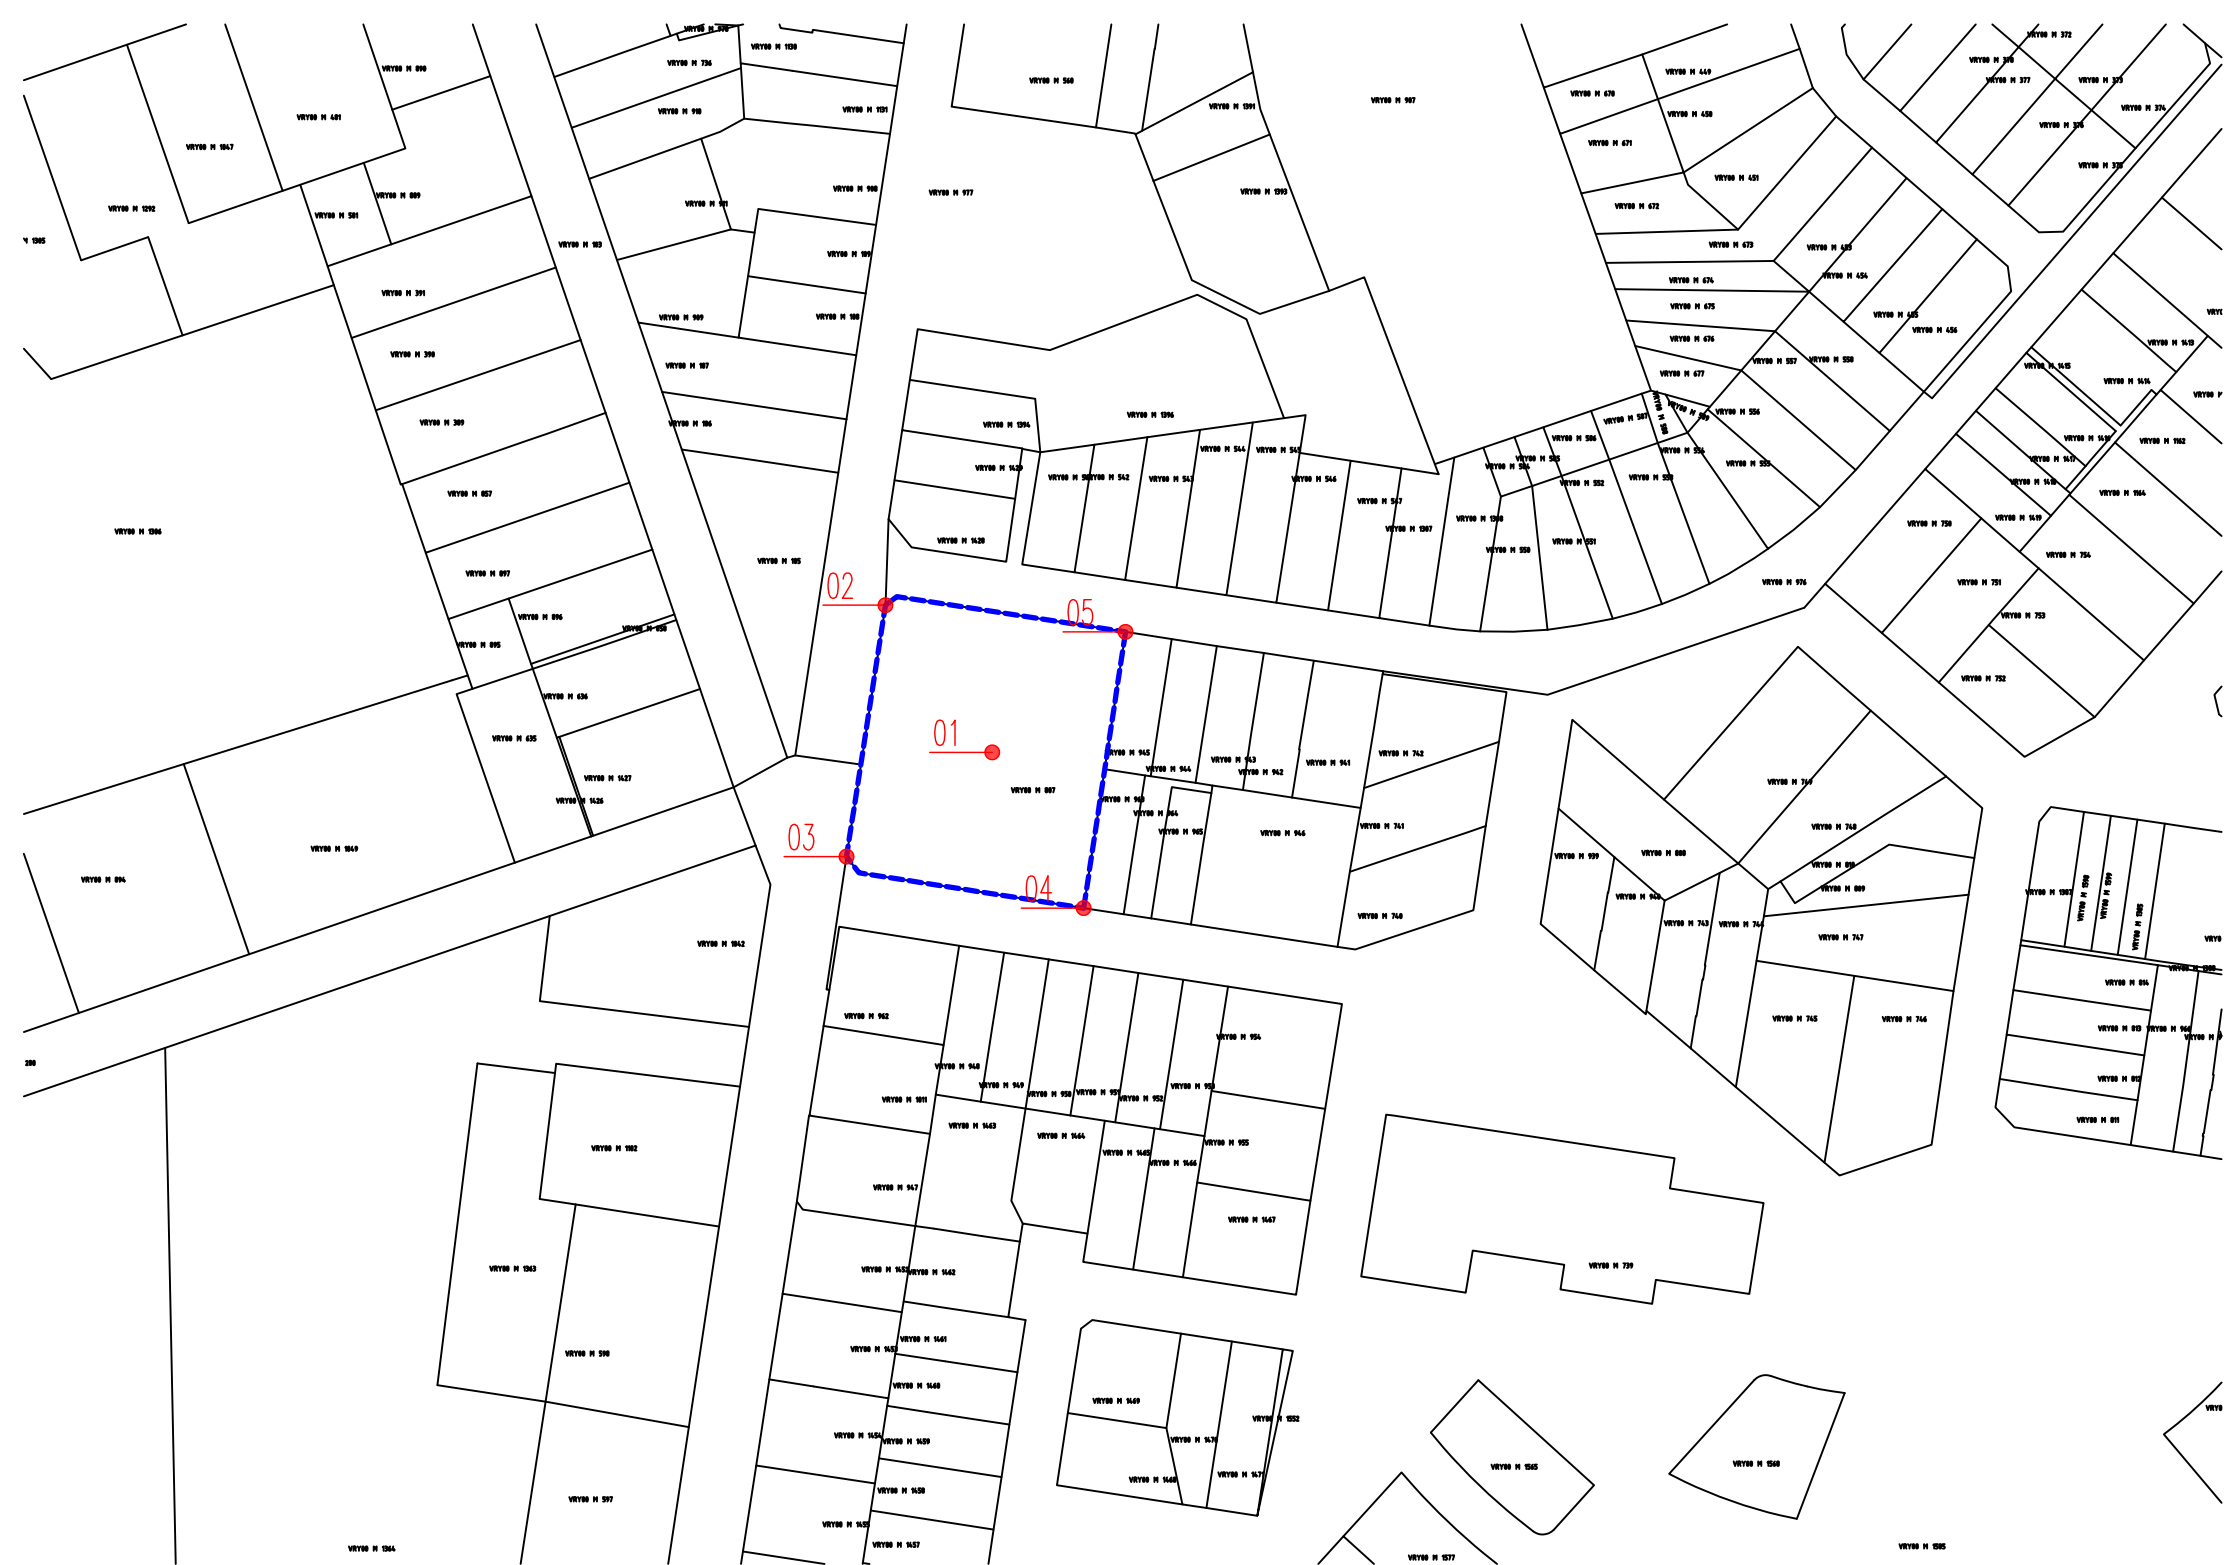

Cumulatieve geurbelasting op receptorpunten, zoals berekend

RecepID	X-coor	Y-coor	Geurnorm	Geurbelasting [OU/m3]
1	190293.0	388838.0	20.000	22.615
2	190272.0	388868.0	20.000	22.193
3	190264.0	388818.0	20.000	23.101
4	190311.0	388808.0	20.000	23.277
5	190319.0	388863.0	20.000	22.263